


1. CABLES, DEVICES AND EQUIPMENT FURNISHED AND INSTALLED BY OWNER. COORDINATE ELECTRICAL WORK WITH OWNER.
2. PROVIDE MINIMUM 3/4" CONDUIT OR AS REQUIRED BY OWNER.

1 NURSE CALL RISER DIAGRAM
NO SCALE

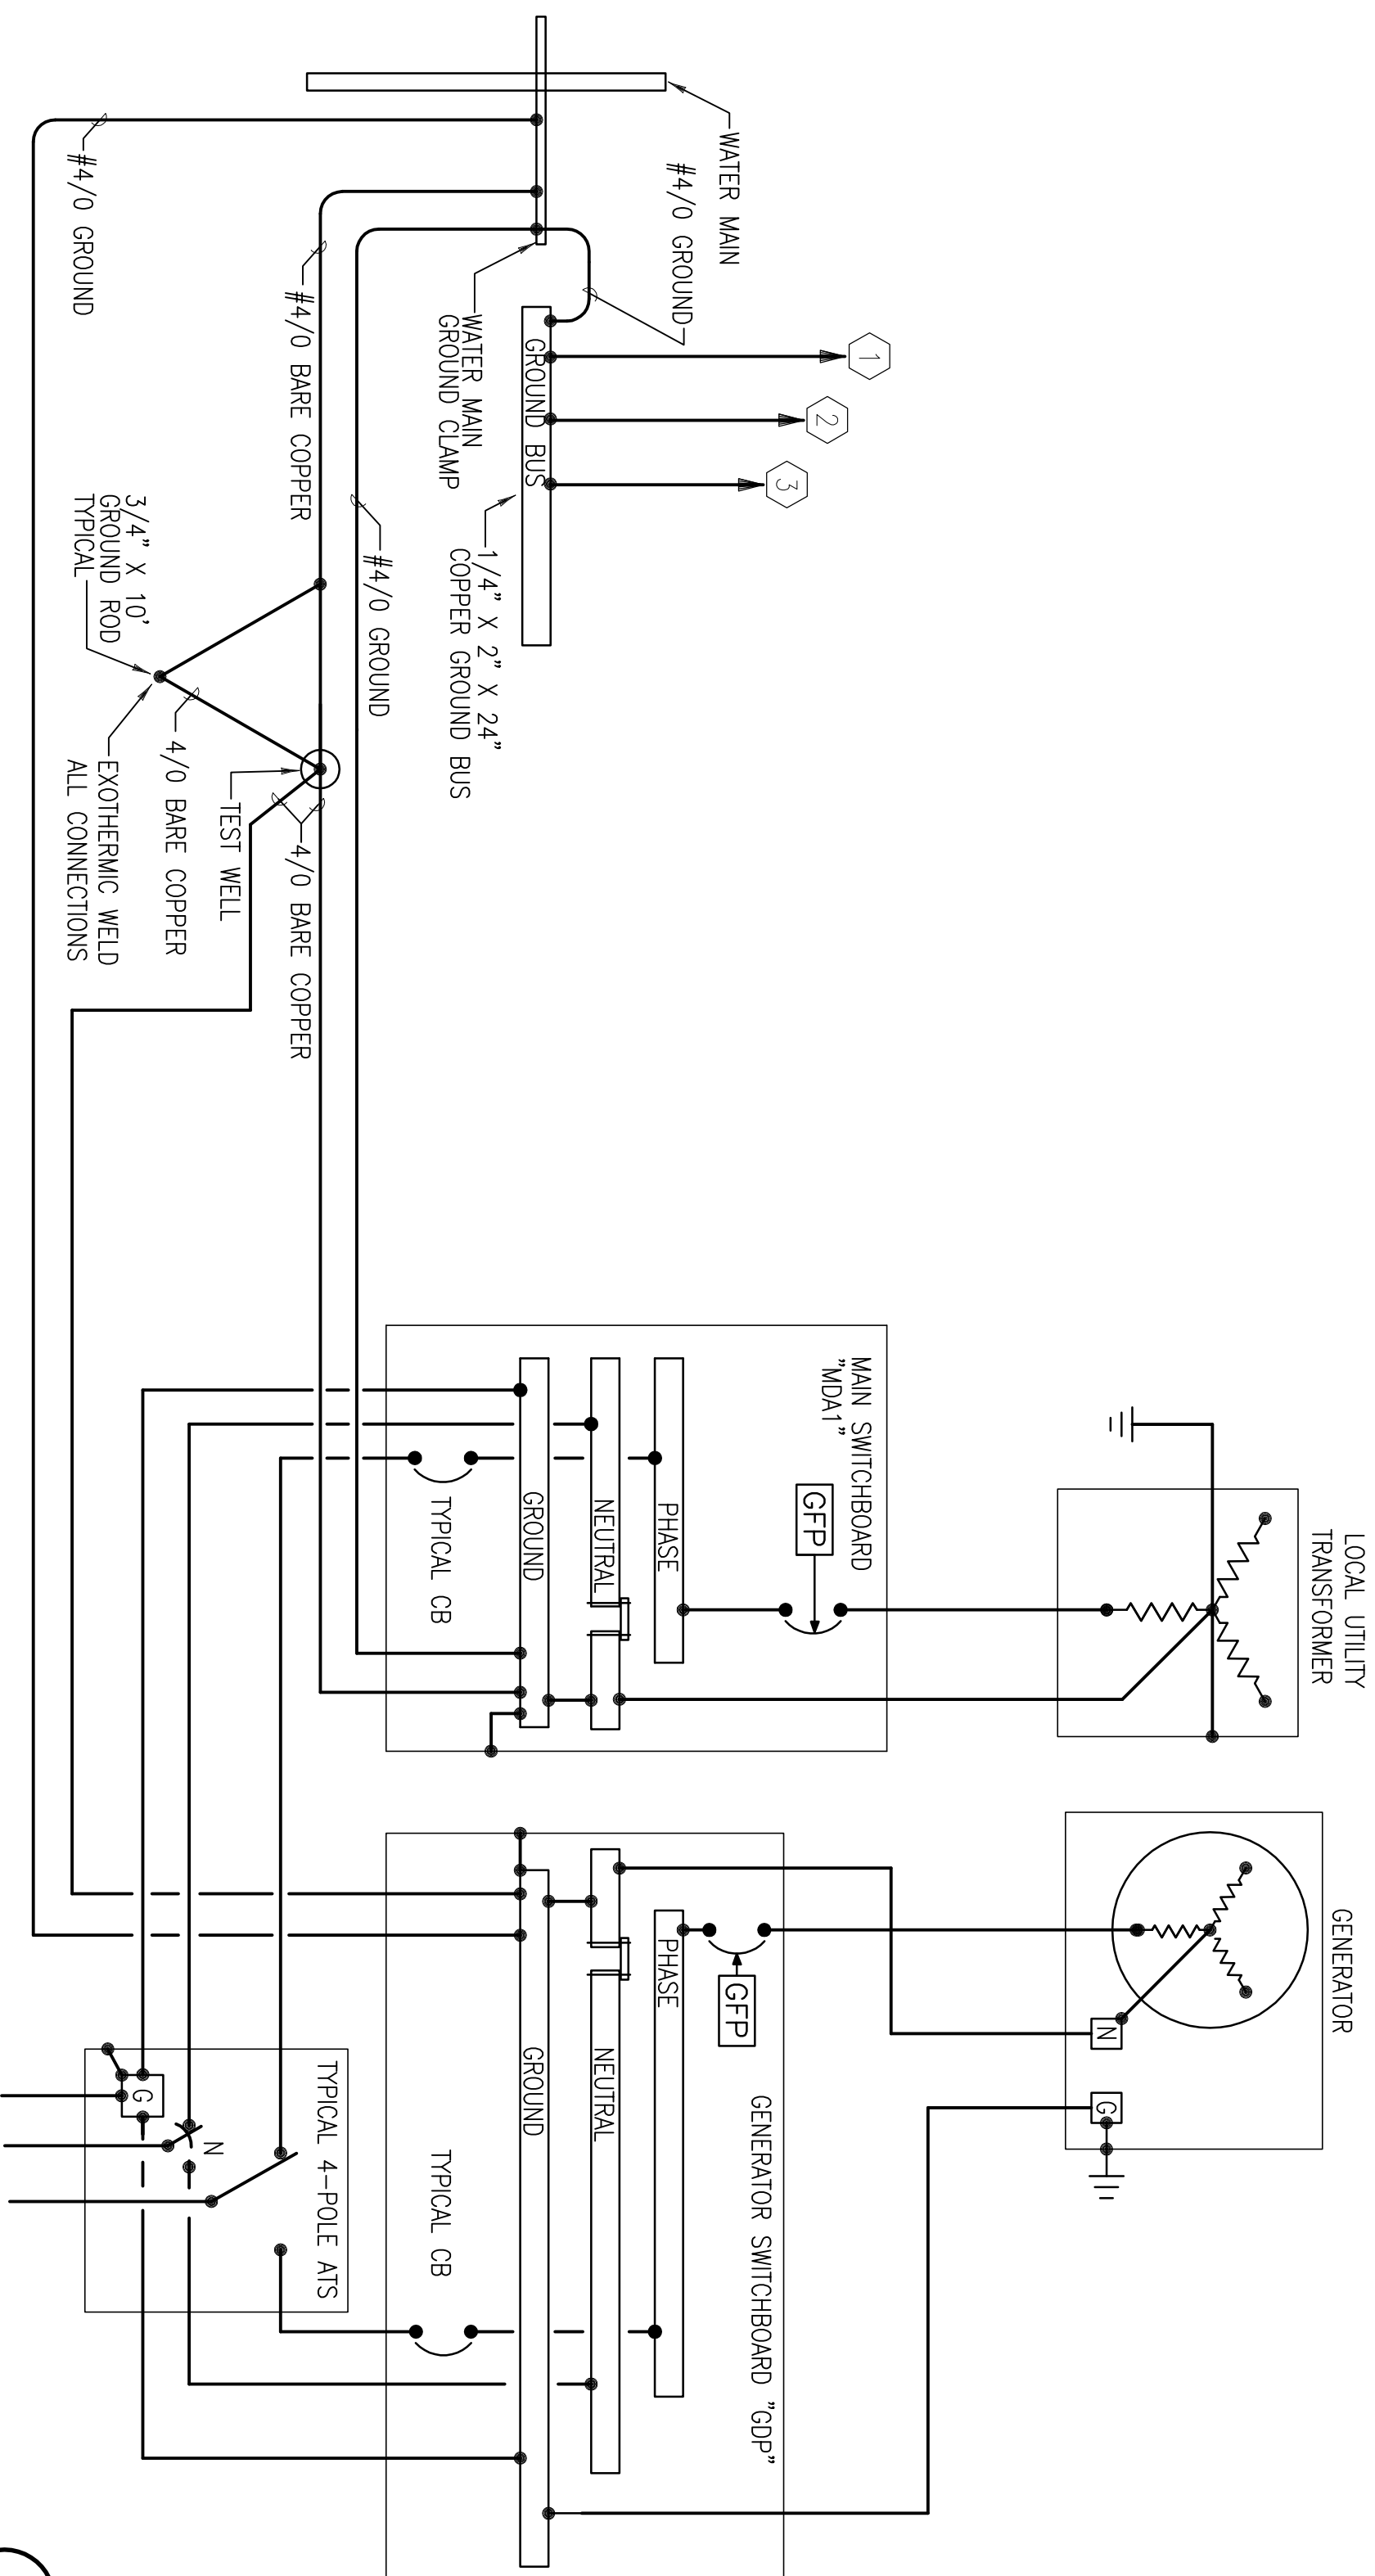


- KEYED NOTES: (SERVICE GROUNDING DETAIL)
- | | |
|---|--|
| ① | #4/0 GROUND TO AREA B ELECTRICAL CLOSET 128 GROUND BUS BAR |
| ② | #4/0 GROUND TO AREA B TELECOMM CLOSET 130 GROUND BUS BAR. |
| ③ | #4/0 GROUND TO BUILDING STEEL. |

3 SERVICE GROUNDING DETAIL


NO SCALE

FULLY SPRINKLERED

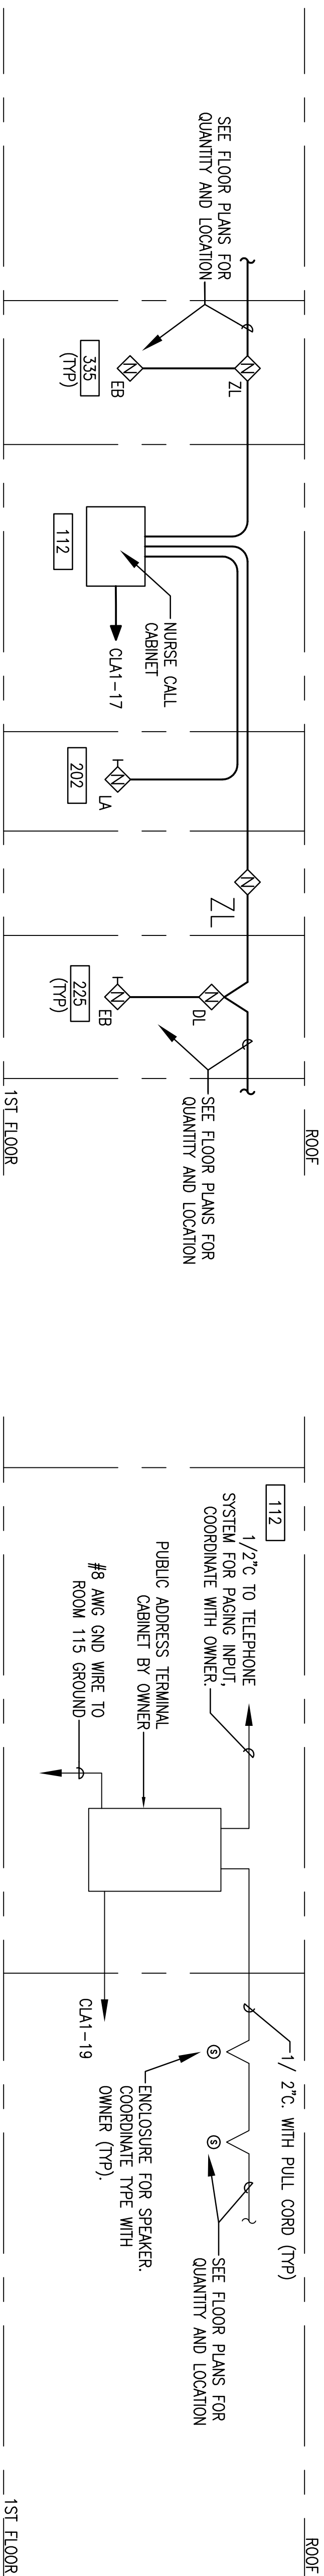[illegible]

- NOTE: CABLES, SPEAKERS, AND EQUIPMENT FURNISHED AND INSTALLED BY OWNER. COORDINATE ELECTRICAL WORK WITH OWNER.

2 PUBLIC ADDRESS SYSTEM RISER DIAGRAM

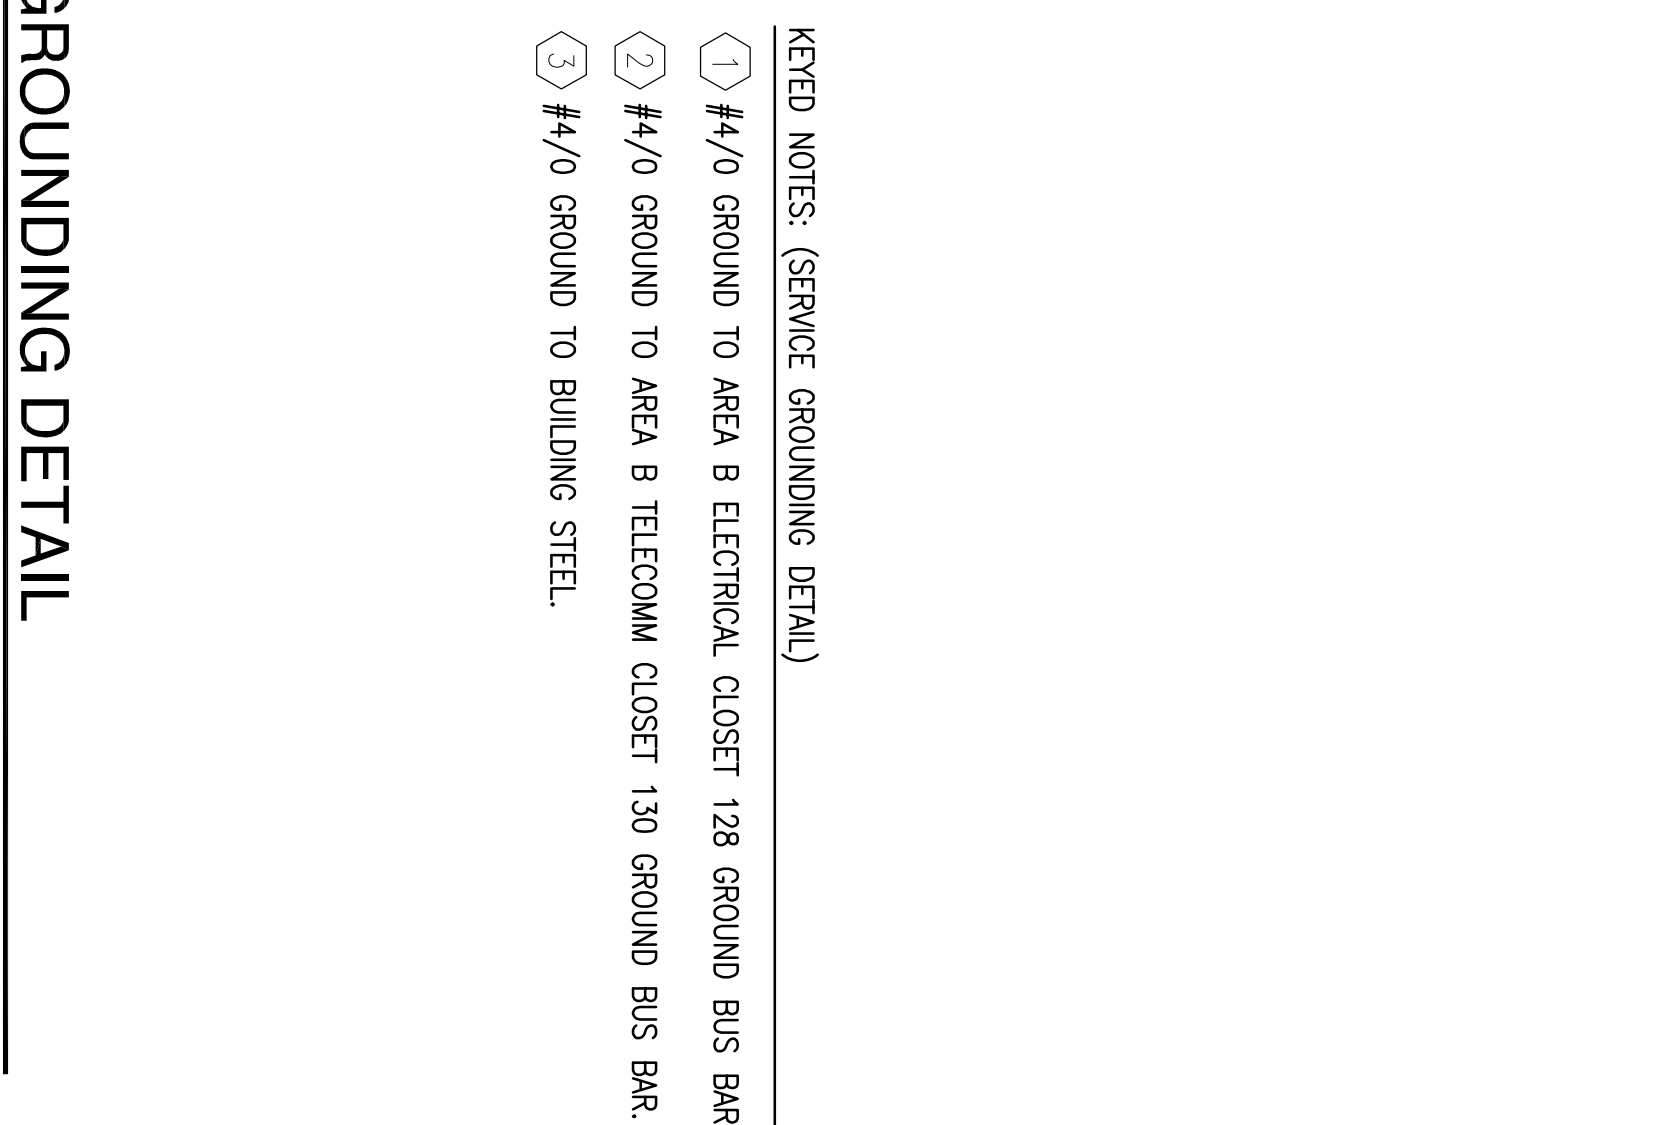

- KEYED NOTES: (SERVICE GROUNDING DETAIL)
- | | |
|---|--|
| ① | #4/0 GROUND TO AREA B ELECTRICAL CLOSET 128 GROUND BUS BAR |
| ② | #4/0 GROUND TO AREA B TELECOMM CLOSET 130 GROUND BUS BAR. |
| ③ | #4/0 GROUND TO BUILDING STEEL. |

3 SERVICE GROUNDING DETAIL

NO SCALE

FULLY SPRINKLERED

[illegible]